



Electrical Data

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	Type	HP	FLA	Part #	KW*	FLA	FLA	FLA	MCA	MOP
DSC0607W	575/3/60	1	6.4	47.8	1	0.33	0.67	1	2.3	3.8	-	-	-	-	-	12.5	15
											-	-	-	3.5	-	16.0	20
											-	-	-	-	1.0	13.5	15
											-	-	-	3.5	1.0	17.0	20
											EH*D-7S05A	5.0	4.8	-	-	12.5	15
														3.5	-	16.0	20
														-	1.0	13.5	15
														3.5	1.0	17.0	20
											EH*D-7S10A	10.0	9.6	-	-	16.8	20
														3.5	-	21.2	25
														-	1.0	18.0	20
														3.5	1.0	22.4	25
											EH*D-7S15A	15.0	14.4	-	-	22.8	25
														3.5	-	27.2	30
														-	1.0	24.0	25
														3.5	1.0	28.4	30
											EH*D-7S20A	20.0	19.2	-	-	28.8	30
														3.5	-	33.2	35
														-	1.0	30.1	35
														3.5	1.0	34.4	35
DSC0723D	208/230/3/60	1	16.1	155	1	0.33	2.0	1	1.2	5.0	-	-	-	-	-	27.2/27.2	40/40
											-	-	-	9.6/8.7	-	36.8/35.9	50/50
											-	-	-	-	2.2/1.9 (1.7/1.5)	29.4/29.1	40/40
											-	-	-	9.6/8.7	2.2/1.9 (1.7/1.5)	39.0/37.8	50/50
											EH*D-3S05A	3.8/5.0	10.4/12.0	-	-	27.2/27.2	40/40
														9.6/8.7	-	36.8/35.9	50/50
														-	2.2/1.9 (1.7/1.5)	29.4/29.1	40/40
														9.6/8.7	2.2/1.9 (1.7/1.5)	39.0/37.8	50/50
											EH*D-3S10A	7.5/10.0	20.8/24.0	-	-	32.2/36.2	40/40
														9.6/8.7	-	44.2/47.1	50/50
														-	2.2/1.9 (1.7/1.5)	35.0/38.6	40/40
														9.6/8.7	2.2/1.9 (1.7/1.5)	47.0/49.5	50/50
											EH*D-3S15A	11.3/15.0	31.3/36.1	-	-	45.3/51.4	50/60
														9.6/8.7	-	57.3/62.2	60/70
														-	2.2/1.9 (1.7/1.5)	48.1/53.7	50/60
														9.6/8.7	2.2/1.9 (1.7/1.5)	60.1/64.6	70/70
											EH*D-3S20A	14.9/19.9	41.5/47.9	-	-	58.1/66.1	60/70
														9.6/8.7	-	70.1/77.0	80/80
														-	2.2/1.9 (1.7/1.5)	60.9/68.5	70/70
														9.6/8.7	2.2/1.9 (1.7/1.5)	72.9/79.3	80/80
											EH*D-3S30A	22.5/30.0	62.5/72.2	-	-	84.4/96.5	90/100
														9.6/8.7	-	96.4/107	100/110
														-	2.2/1.9 (1.7/1.5)	87.2/98.8	90/100
														9.6/8.7	2.2/1.9 (1.7/1.5)	99.2/110	100/110

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	Type	HP	FLA	Part #	KW*	FLA			MCA	MOP
DSC0723W	208/230/3/60	1	16.1	155	1	0.33	2.0	1	2.3	7.7	-	-	-	-	-	29.9/29.9	45/45
											-	-	-	9.6/8.7	-	39.5/38.6	50/50
											-	-	-	-	2.2/1.9 (1.7/1.5)	32.1/31.8	45/45
											-	-	-	9.6/8.7	2.2/1.9 (1.7/1.5)	41.7/40.5	50/50
											EH*D-3S05A	3.8/5.0	10.4/12.0	-	-	29.9/29.9	45/45
														9.6/8.7	-	39.5/38.6	50/50
														-	2.2/1.9 (1.7/1.5)	32.1/31.8	45/45
														9.6/8.7	2.2/1.9 (1.7/1.5)	41.7/40.5	50/50
											EH*D-3S10A	7.5/10.0	20.8/24.0	-	-	35.6/39.6	45/45
														9.6/8.7	-	47.6/50.5	50/60
														-	2.2/1.9 (1.7/1.5)	38.3/42.0	45/45
														9.6/8.7	2.2/1.9 (1.7/1.5)	50.3/52.8	60/60
											EH*D-3S15A	11.3/15.0	31.3/36.1	-	-	48.7/54.7	50/60
														9.6/8.7	-	60.7/65.6	70/70
														-	2.2/1.9 (1.7/1.5)	51.5/57.1	60/60
														9.6/8.7	2.2/1.9 (1.7/1.5)	63.5/68.0	70/70
											EH*D-3S20A	14.9/19.9	41.5/47.9	-	-	61.5/69.5	70/70
														9.6/8.7	-	73.5/80.3	80/90
														-	2.2/1.9 (1.7/1.5)	64.2/71.8	70/80
														9.6/8.7	2.2/1.9 (1.7/1.5)	76.2/82.7	80/90
DSC0724D	460/3/60	1	7.0	70.8	1	0.33	0.85	1	1.2	2.5	-	-	-	-	-	12.2	15
											-	-	-	4.3	-	16.5	20
											-	-	-	-	0.9 (0.5)	13.1	15
											-	-	-	4.3	0.9 (0.5)	17.4	20
											EH*D-4S05A	5.0	6.0	-	-	12.2	15
														4.3	-	16.5	20
														-	0.9 (0.5)	13.1	15
														4.3	0.9 (0.5)	17.4	20
											EH*D-4S10A	10.0	12.0	-	-	18.2	20
														4.3	-	23.5	25
														-	0.9 (0.5)	19.3	20
														4.3	0.9 (0.5)	24.7	25
											EH*D-4S15A	15.0	18.0	-	-	25.7	30
														4.3	-	31.1	35
														-	0.9 (0.5)	26.8	30
														4.3	0.9 (0.5)	32.2	35
											EH*D-4S20A	20.0	24.1	-	-	33.2	35
														4.3	-	38.6	40
														-	0.9 (0.5)	34.3	35
														4.3	0.9 (0.5)	39.7	40
											EH*D-4S30A	30.0	36.1	-	-	48.2	50
														4.3	-	53.6	60
														-	0.9 (0.5)	49.4	50
														4.3	0.9 (0.5)	54.7	60

Model Number	Electrical Rating	Compressor			Outdoor Fan Motor			Indoor Fan Motor			Optional Electric Heat			Optional Powered Convenience Outlet	Optional Power Exhaust	Power Supply	
		QTY	RLA	LRA	QTY	HP	FLA	Type	HP	FLA	Part #	KW*	FLA			MCA	MOP
DSC0724W	460/3/60	1	7.0	70.8	1	0.33	0.85	1	2.3	4.5	-	-	-	-	-	14.2	20
											-	-	-	4.3	-	18.5	25
											-	-	-	-	0.9 (0.5)	15.1	20
											-	-	-	4.3	0.9 (0.5)	19.4	25
											-	-	-	-	-	14.2	20
											EH*D-4S05A	5.0	6.0	4.3	-	18.5	25
											-	-	-	-	0.9 (0.5)	15.1	20
											-	-	-	4.3	0.9 (0.5)	19.6	25
											-	-	-	-	-	20.7	25
											EH*D-4S10A	10.0	12.0	4.3	-	26.0	30
											-	-	-	-	0.9 (0.5)	21.8	25
											-	-	-	4.3	0.9 (0.5)	27.2	30
											-	-	-	-	-	28.2	30
											EH*D-4S15A	15.0	18.0	4.3	-	33.6	35
											-	-	-	-	0.9 (0.5)	29.3	30
											-	-	-	4.3	0.9 (0.5)	34.7	35
											-	-	-	-	-	35.7	40
											EH*D-4S20A	20.0	24.1	4.3	-	41.1	45
											-	-	-	-	0.9 (0.5)	36.8	40
											-	-	-	4.3	0.9 (0.5)	42.2	45
											-	-	-	-	-	50.7	60
											EH*D-4S30B	30.0	36.1	4.3	-	56.1	60
											-	-	-	-	0.9 (0.5)	51.9	60
											-	-	-	4.3	0.9 (0.5)	57.2	60
DSC0727D	575/3/60	1	6.0	58.2	1	0.33	0.67	1	1.2	2.0	-	-	-	-	-	10.2	15
											-	-	-	3.5	-	13.7	15
											-	-	-	-	1.0	11.2	15
											-	-	-	3.5	1.0	14.7	20
											-	-	-	-	-	10.2	15
											EH*D-7S05A	5.0	4.8	3.5	-	13.7	15
											-	-	-	-	1.0	11.2	15
											-	-	-	3.5	1.0	14.7	20
											-	-	-	-	-	14.5	15
											EH*D-7S10A	10.0	9.6	3.5	-	18.9	20
											-	-	-	-	1.0	15.8	20
											-	-	-	3.5	1.0	20.2	25
											-	-	-	-	-	20.5	25
											EH*D-7S15A	15.0	14.4	3.5	-	24.9	25
											-	-	-	-	1.0	21.8	25
											-	-	-	3.5	1.0	26.2	30
											-	-	-	-	-	26.6	30
											EH*D-7S20A	20.0	19.2	3.5	-	30.9	35
											-	-	-	-	1.0	27.8	30
											-	-	-	3.5	1.0	32.2	35
											-	-	-	-	-	38.6	40
											EH*D-7S30A	30.0	28.9	3.5	-	43.0	45
											-	-	-	-	1.0	39.8	40
											-	-	-	3.5	1.0	44.2	45
DSC0727W	575/3/60	1	6.0	58.2	1	0.33	0.67	1	2.3	3.8	-	-	-	-	-	12.0	15
											-	-	-	3.5	-	15.5	20
											-	-	-	-	1.0	13.0	15
											-	-	-	3.5	1.0	16.5	20
											-	-	-	-	-	12.0	15
											EH*D-7S05A	5.0	4.8	3.5	-	15.5	20
											-	-	-	-	1.0	13.0	15
											-	-	-	3.5	1.0	16.5	20
											-	-	-	-	-	16.8	20
											EH*D-7S10A	10.0	9.6	3.5	-	21.2	25
											-	-	-	-	1.0	18.0	20
											-	-	-	3.5	1.0	22.4	25
											-	-	-	-	-	22.8	25
											EH*D-7S15A	15.0	14.4	3.5	-	27.2	30
											-	-	-	-	1.0	24.0	25
											-	-	-	3.5	1.0	28.4	30
											-	-	-	-	-	28.8	30
											EH*D-7S20A	20.0	19.2	3.5	-	33.2	35
											-	-	-	-	1.0	30.1	35
											-	-	-	3.5	1.0	34.4	35
											-	-	-	-	-	40.8	45
											EH*D-7S30B	30.0	28.9	3.5	-	45.2	50
											-	-	-	-	1.0	42.1	45
											-	-	-	3.5	1.0	46.5	50

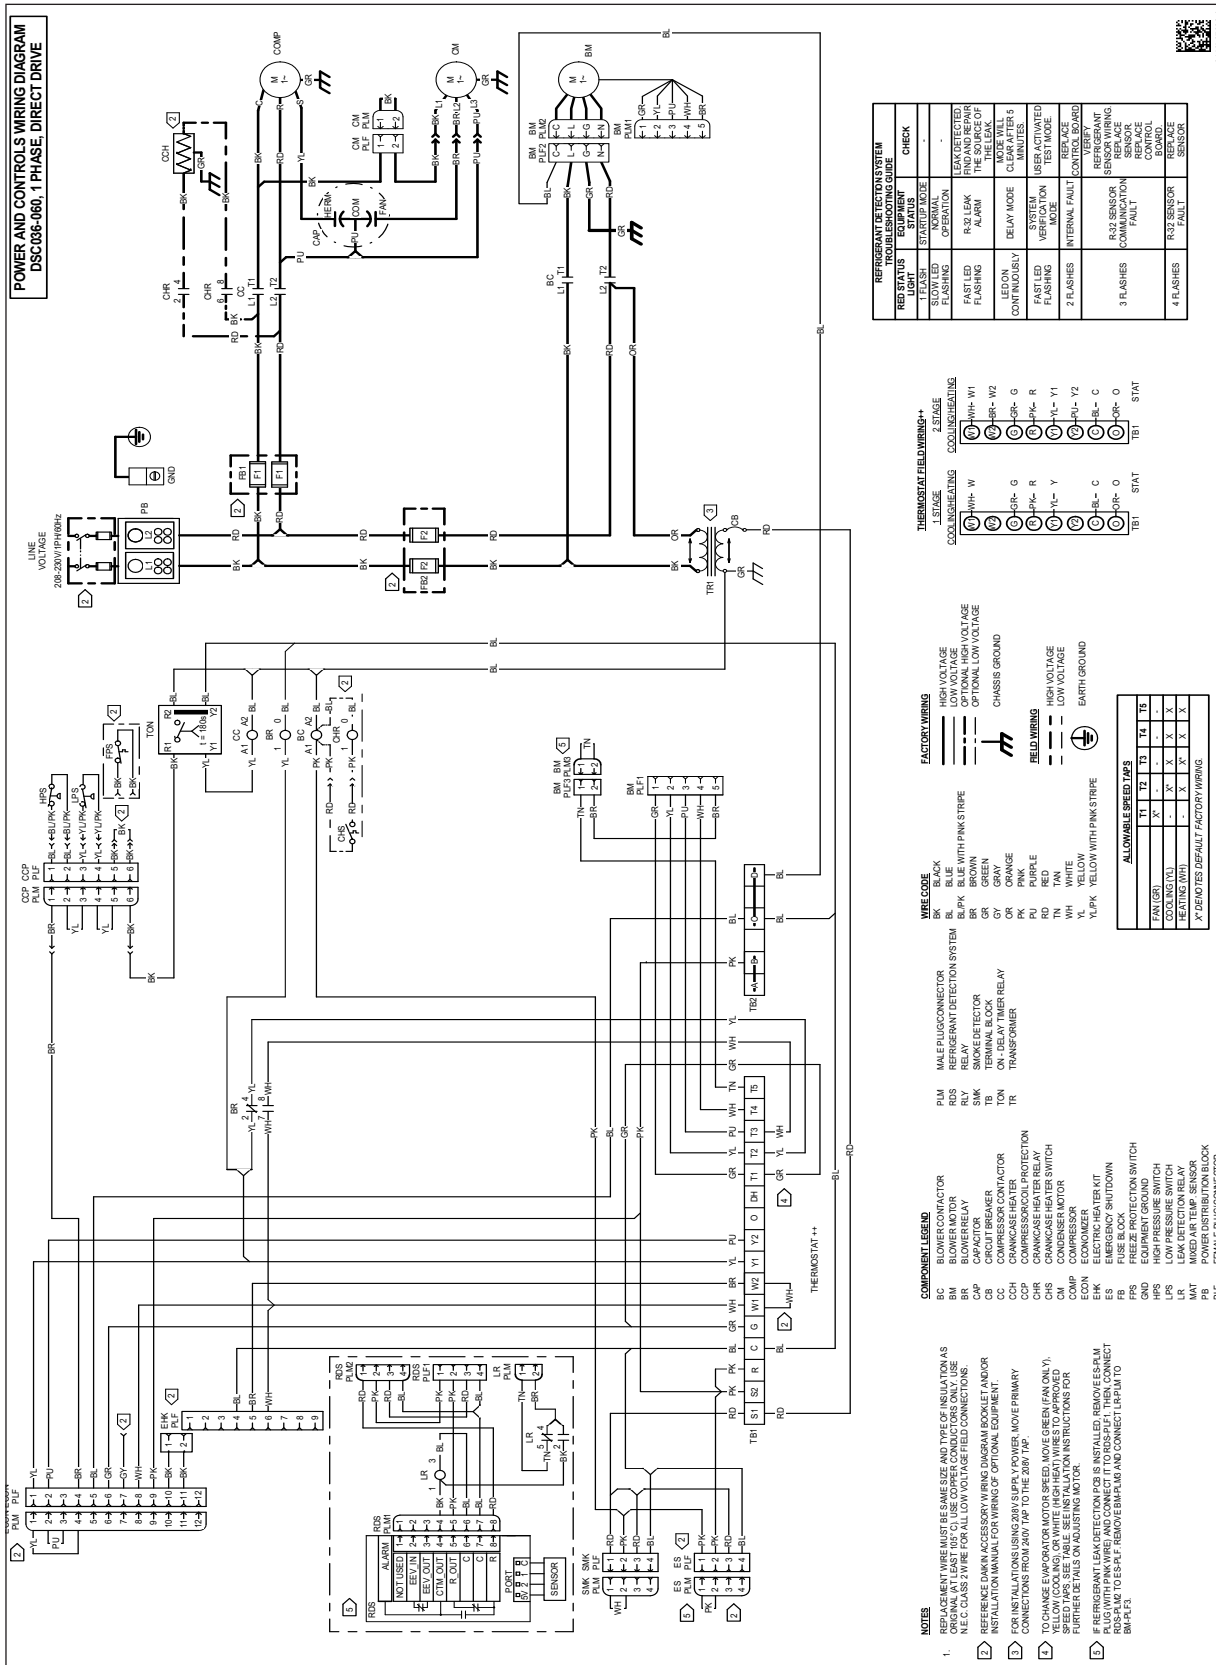


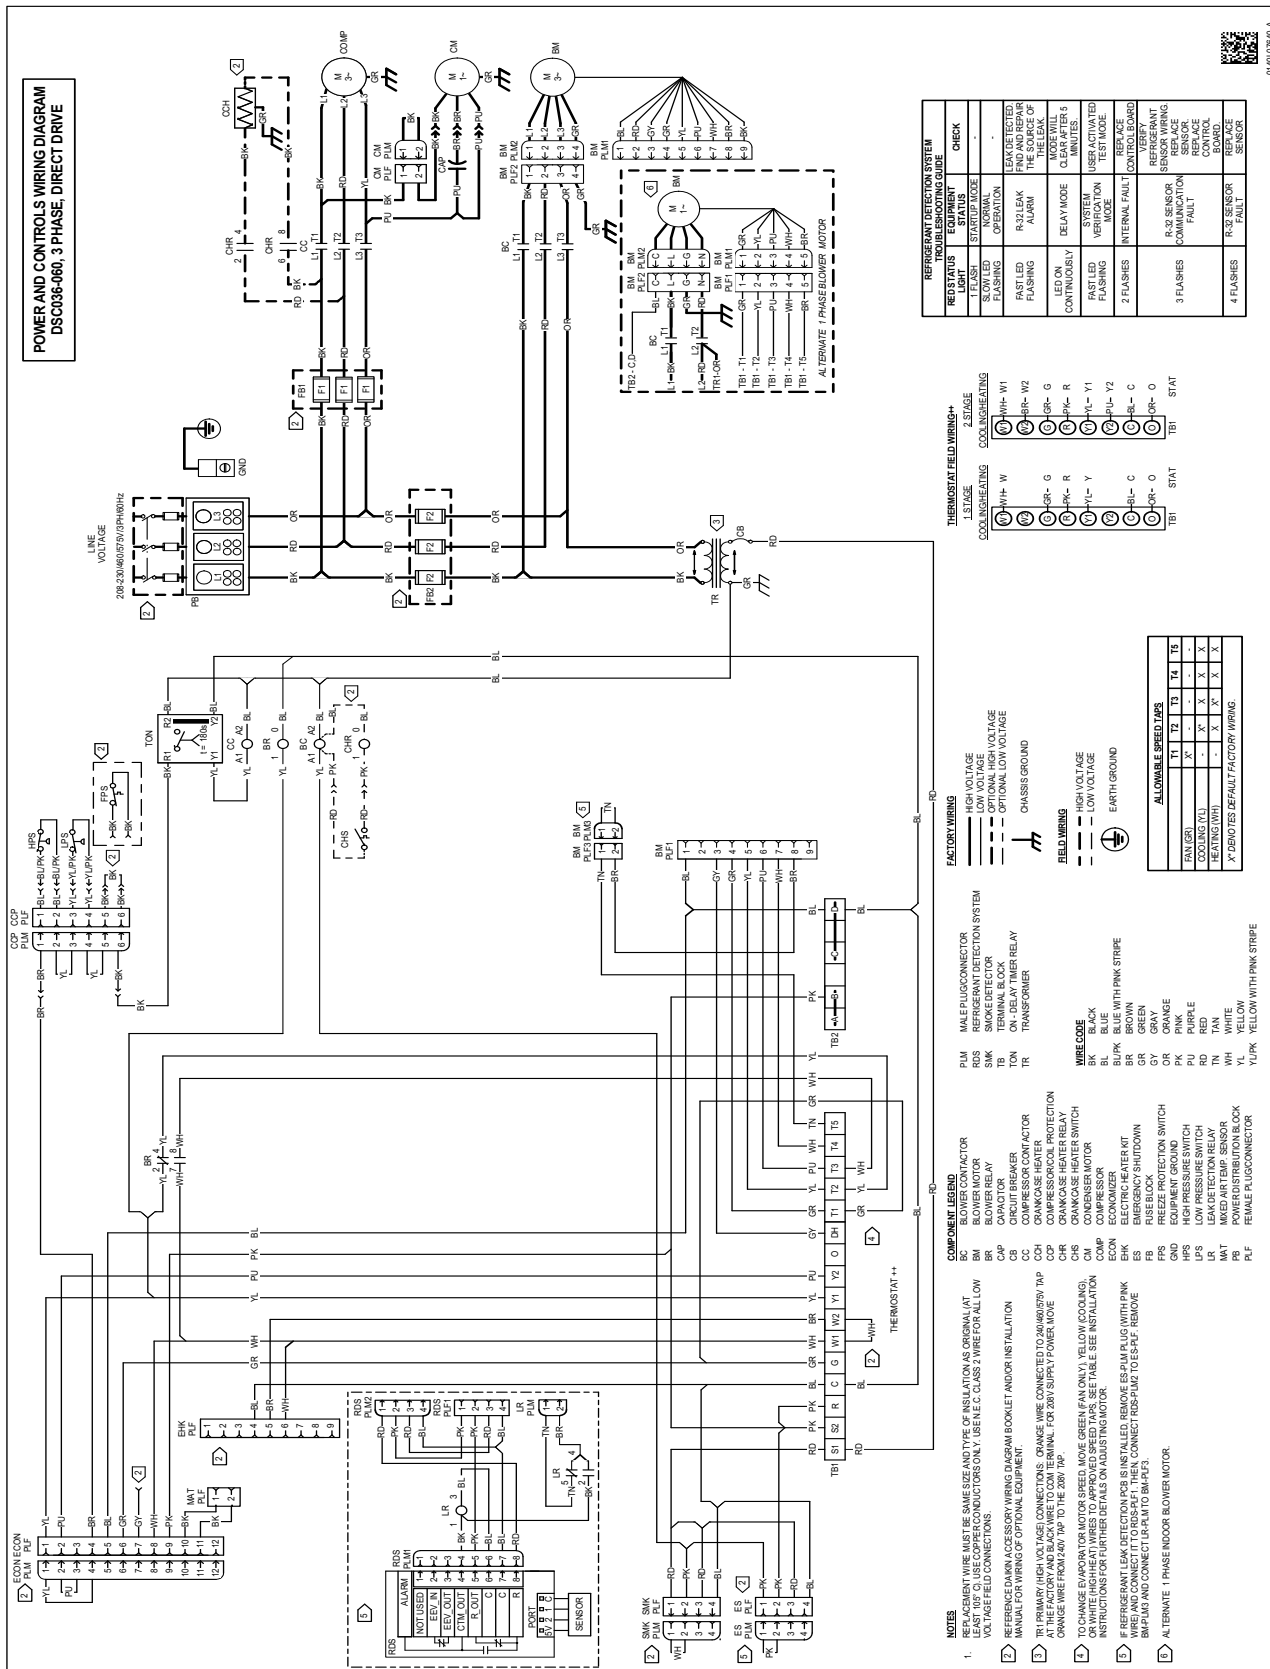

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

WARNING



High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.





WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



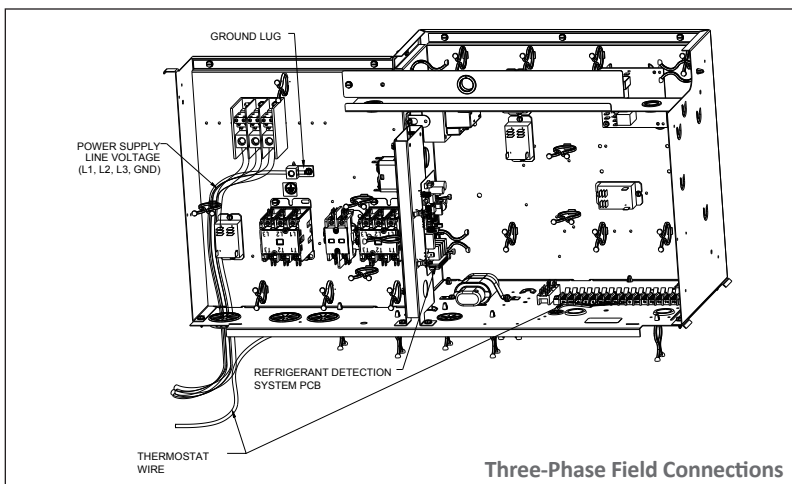
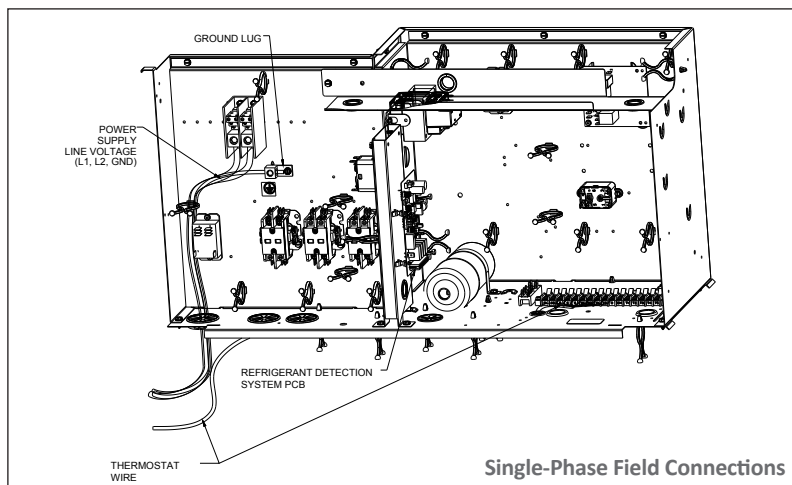


NOTE: Components may vary depending on unit configuration.

Unit Clearances

Service Clearance

Allow for recommended service clearances as shown in figure to the right. In situations that have multiple units, a 36" minimum clearance is required between the condenser coils. A clearance of 48" is recommended on all sides of the unit to allow service access and to ensure proper ventilation and condenser airflow. The top of the unit should be unobstructed. Provide a roof walkway along the sides of the unit for service and access to controls and components. Contact your Daikin sales representative for service requirements less than those recommended.

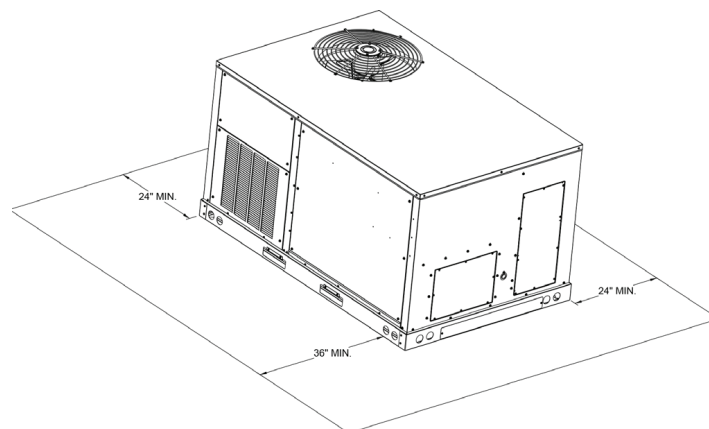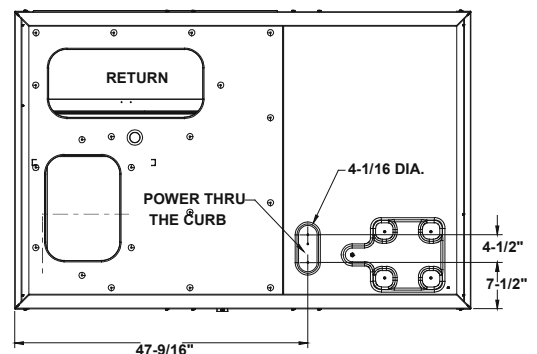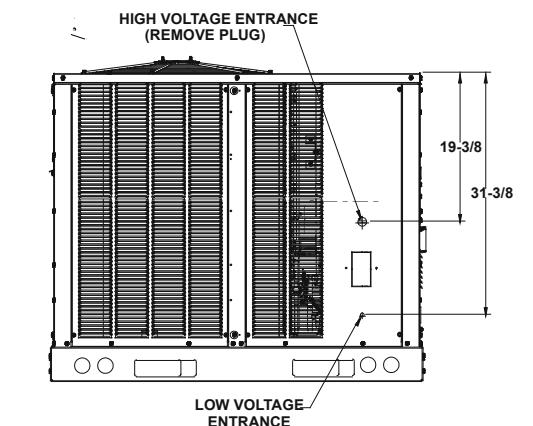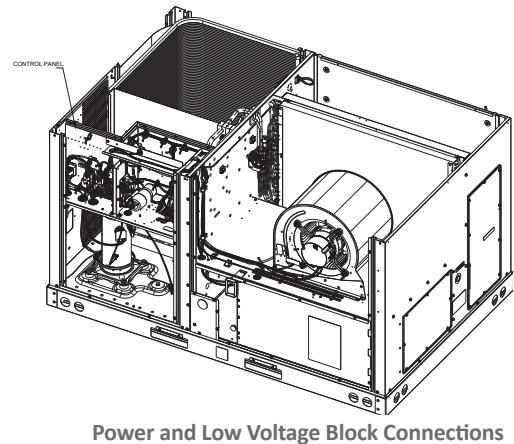

Unit Location


The structural engineer must verify that the roof has adequate support and ability to minimize deflection. Take extreme caution when using on a wooden roof structure. Unit condenser coils should be in a location that avoids any heated exhaust air.

Allow sufficient space around the unit for maintenance/service clearance. Consult your Daikin sales representative if available clearances do not meet minimum recommendations.

Where code considerations, such as the NEC, require extended clearances, these take precedence.

Provisions for forks have been included in the unit base frame. No other fork locations are approved.

- » Unit must be lifted by the four lifting holes located at the base frame corners.
- » Lifting cables should be attached to the unit with shackles.
- » The distance between the crane hook and the top of the unit must not be less than 60".
- » Two spreader bars must span over the unit to prevent damage to the cabinet by the lift cables. Spreader bars must be of sufficient length so that cables do not come in contact with the unit during transport. Remove wood struts mounted beneath unit base

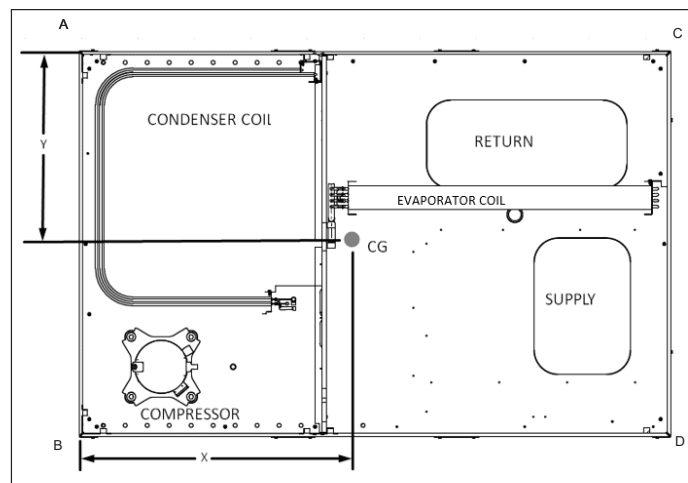

~ CORNER & CENTER-OF-GRAVITY LOCATIONS

frame before setting unit on roof curb. These struts are intended to protect unit base frame from forklift damage. To remove the struts, extract the sheet metal retainers and pull the struts through the base of the unit. Refer to rigging label on the unit.

Important: If using bottom discharge with roof curb, ductwork should be attached to the curb prior to installing the unit. Refer to the Roof Curb Installation Instructions for proper curb installation. Curbing must be installed in compliance with the National Roofing Contractors Association Manual. Lower unit carefully onto roof mounting curb. While rigging the unit, the center of gravity will cause the condenser end to be lower than the supply air end. Bring condenser end of unit into alignment with the curb. With condenser end of the unit resting on curb member and using curb as a fulcrum, lower opposite end of the unit until entire unit is seated on the curb. When a rectangular cantilever curb is used, take care to center the unit. Check for proper alignment and orientation of supply and return openings with duct.

Roof Curb Installation

The roof curb is field-assembled and must be installed level (within 1/16" per foot side to side). A sub-base must be constructed by the contractor in applications involving pitched roofs. Gaskets are furnished and must be installed between the unit and curb. For proper installation, follow NRCA guidelines. In applications requiring post and rail installation, an I-beam securely mounted on multiple posts should support the unit on each side. In addition, the insulation on the underside of the unit should be protected from the elements. Applications in geographic areas subjected to seismic or hurricane conditions must meet code requirements for fastening the unit to the curb and the curb to the building structure. For further and more detailed information please refer to our Daikin Light Commercial Packaged unit IOD.

Weights

Model	Shipping Weight (lbs)	Operating Weight (lbs)	Corner Weights (lbs)				Length	Width
			A	B	C	D	X (in)	Y (in)
DSC0361D	554	484	117	142	80	145	34 $\frac{3}{4}$	28 $\frac{5}{8}$
DSC0363D	552	482	117	140	80	145	34 $\frac{9}{16}$	28 $\frac{9}{16}$
DSC0364D	560	490	117	142	80	151	34 $\frac{3}{4}$	28 $\frac{7}{8}$
DSC0367D	560	490	117	142	80	151	34 $\frac{3}{4}$	28 $\frac{7}{8}$
DSC0481D	577	507	134	152	87	134	32 $\frac{1}{2}$	27 $\frac{7}{8}$
DSC0483D	572	502	134	147	87	134	32 $\frac{9}{16}$	27 $\frac{1}{2}$
DSC0484D	576	506	134	147	87	138	32 $\frac{1}{2}$	27 $\frac{3}{16}$
DSC0487D	576	506	134	147	87	138	32 $\frac{1}{2}$	27 $\frac{3}{16}$
DSC0601D	582	512	113	166	104	129	33 $\frac{11}{16}$	27 $\frac{13}{16}$
DSC0603D	578	508	113	162	104	129	33 $\frac{15}{16}$	27 $\frac{11}{16}$
DSC0604D	582	512	113	162	104	133	34 $\frac{1}{4}$	27 $\frac{13}{16}$
DSC0607D	582	512	113	162	104	133	34 $\frac{1}{4}$	27 $\frac{13}{16}$
DSC0723D	651	581	143	178	90	170	33 $\frac{3}{4}$	28 $\frac{15}{16}$
DSC0724D	651	581	143	178	90	170	33 $\frac{3}{4}$	28 $\frac{15}{16}$
DSC0727D	651	581	143	178	90	170	33 $\frac{3}{4}$	28 $\frac{15}{16}$

For details on accessories refer to document **PM-LC-ACCESSORIES**

Notes

Our continuing commitment to quality products may mean a change in specifications without notice.
©2026 DAIKIN COMFORT TECHNOLOGIES MANUFACTURING, INC. • Houston, Texas • Printed in the USA.