Job Name/Location: **Tag No.:**

Date: **For:** ☐ File ☐ Resubmit ☐ Approval ☐ Other _____

PO No.:

Architect: **GC:**

Engr: **Mech:**

Rep:
(Company) (Project Manager)



KNMLB361A
R32 Multi F Multi-Position Air Handling Unit
36,000 Btu/h Indoor Unit

Performance:

Nominal Cooling Capacity (Btu/h)	36,000
Nominal Heating Capacity (Btu/h)	40,000

Cooling Nominal Test Conditions:
Indoor: 80°F DB / 67°F WB
Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions:
Indoor: 70°F DB / 60°F WB
Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V/Hz/Ø)[1,2]	208-230 / 60 / 1
Rated Amps (A)	3.4

Piping:

Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
Liquid Connection (in., O.D.)	3/8 Flare
Vapor Connection (in., O.D.)	5/8 Flare
Drain (in., O.D. / I.D.)	3/4 FPT
Temperature Sensor	Thermistor

Standard Features:

- Access Panel for Field Supplied Air Filter

Controls Features:

- Inverter (variable speed fan)
- Hot start
- Self diagnosis
- Soft dry operation
- Auto operation
- Auto restart
- Sleep mode
- Timer (on/off/weekly)
- ESP control
- R32 leak detection sensor
- Integrated dry contact for 3rd party thermostat

Optional Accessories:

□ Single-Port Shutoff Valve - PRHPZ010A
□ Auxiliary Heater Kit - PRARH1[4]
□ Electric Heater Kits - ANEHxx3Cx[5]
□ Downflow Conversion Kit - PNDFA0
□ Wi-Fi Module - PWFMDD200

Controller Options:

□ MultiSITE™ CRC* Controllers
□ Simple Remote Controllers
□ Standard III Remote Controllers
□ Deluxe Remote Controller
□ Wireless Remote Controller[6]
□ Remote Temperature Button Sensor
□ Dry Contacts

Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R32
Refrigerant Control	EEV
Sound Pressure (H/M/L) dB(A)[3]	40 / 37 / 35
Filter Dimensions[7] (in)	20 x 20 x 1
Net Weight (lbs.)	138.2
Shipping Weight (lbs.)	152.8

Fan:

Type	Sirocco
Quantity	1
Motor/Drive	Brushless Digitally Controlled / Direct
Air Flow H/M/L (CFM)	1,050 / 980 / 900
Minimum~Maximum External Static Pressure[8] (in wg)	0.1~1.0
Fan Setting Value	N/A - Constant Flow
Dehumidification (pts./hr.)	7.17

Notes:

1. Acceptable operating voltage: 187V-253V.
2. The power wiring and the communication wiring from the outdoor unit to the indoor unit, or from the branch distribution unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
a. Power wiring and communication wiring from outdoor unit to indoor unit (No. x AWG) 3 x 14 / 2 x 18.
b. Power wiring and communication wiring from branch distribution unit to indoor unit (No. x AWG) 3 x 14 / 2 x 18.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. If a Third-Party Dry Contact and an LG internal heater or an LG Auxiliary Heater Kit is installed, supplemental heat capability cannot be controlled by the Third-Party Thermostat.
5. Electric heater accessory is available in 3~10kW capacities for 12/18/24/30k Multi F Multi-Position Air Handling Units. For 36k units, electric heater accessory is available in 3~15kW capacities. Refer to the Engineering Manual for details.
6. Requires an LG wall controller because Multi-Position Air Handling Units do not have infrared receiver.
7. Actual filter sizes may vary.
8. Maximum static pressure may result in reduced airflow (CFM).
9. See Engineering Manual for sensible and latent capacities.
10. The indoor unit comes with a dry helium charge.
11. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%.
12. Must follow installation instructions in the applicable LG installation manual.

AHRI CERTIFIED® www.ahridirectory.org
Unitary Small HP
AHRI Standard 210/240
Certification applies only when the complete system is listed with AHRI.

For a complete list of available accessories, contact your LG representative.
For continual product development, LG reserves the right to change specifications without notice.
© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com


Job Name/Location: _____

KNMLB361A
R32 Multi F Multi-Position Air Handling Unit
36,000 Btu/h Indoor Unit

Tag No.: _____
Date: _____
PO No.: _____


Factory Configurations

Vertical Upflow

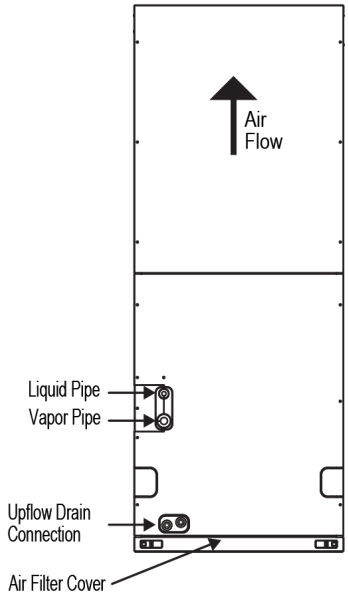


Field Configurations

Vertical Downflow

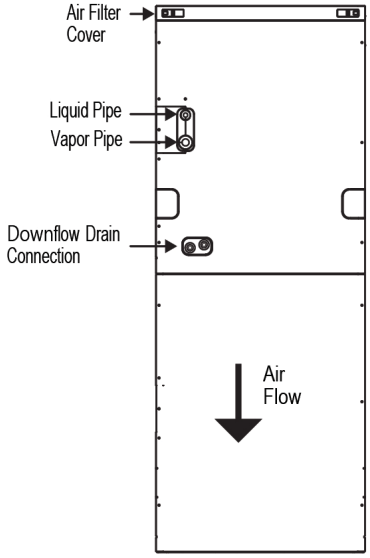


Requires vertical downflow kit

Horizontal Left

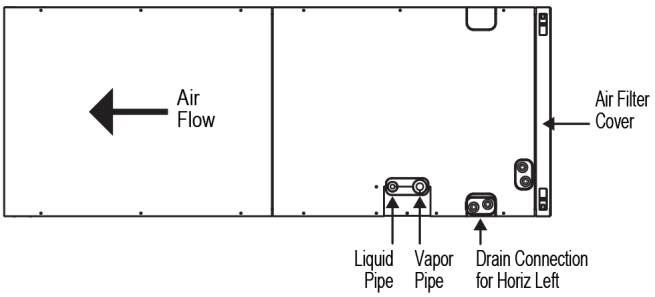

Horizontal Right

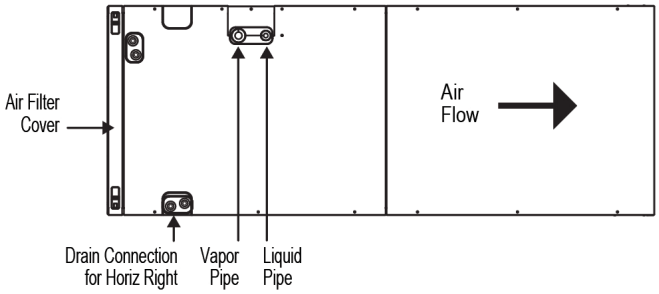

For continual product development, LG reserves the right to change specifications without notice.
© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

Job Name/Location: _____

KNMLB361A


R32 Multi F Multi-Position Air Handling Unit

36,000 Btu/h Indoor Unit


Tag No.: _____

Date: _____


PO No.: _____

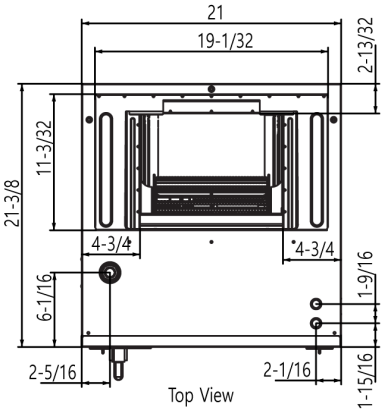


Top View

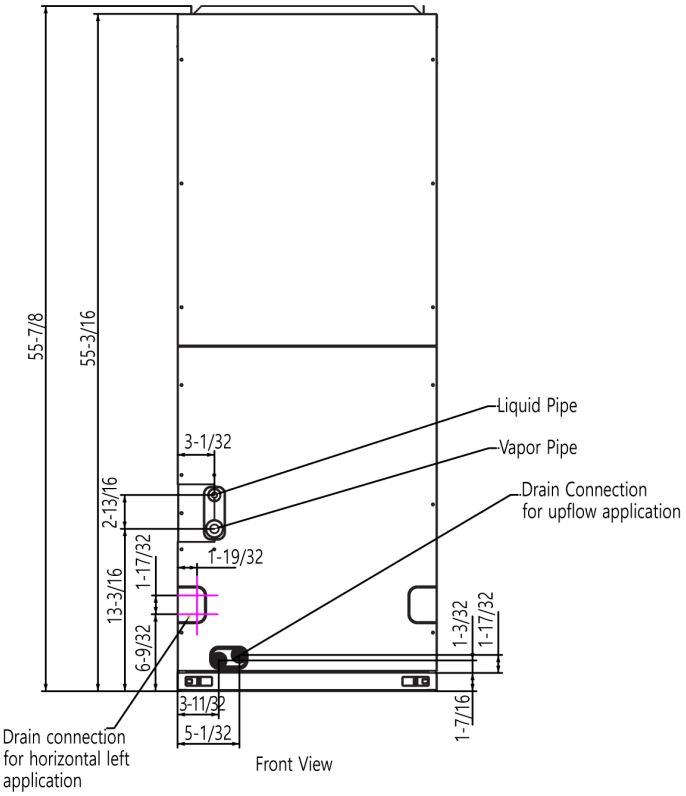

Front View

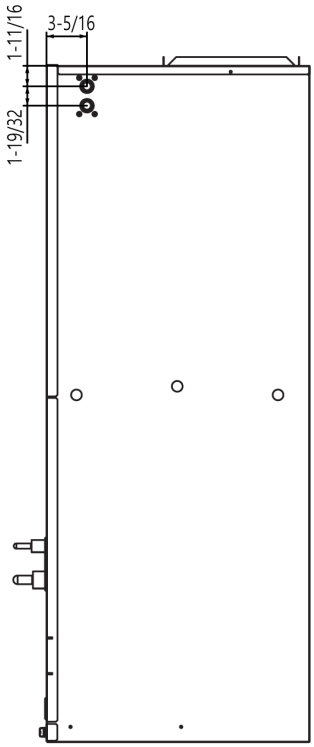

Side View

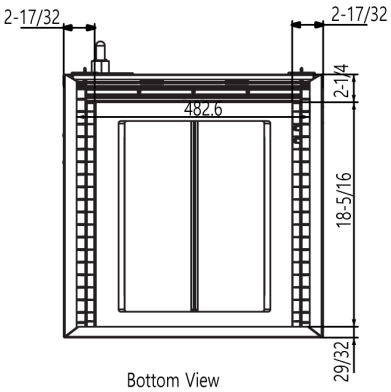

Bottom View

For continual product development, LG reserves the right to change specifications without notice.
© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com